
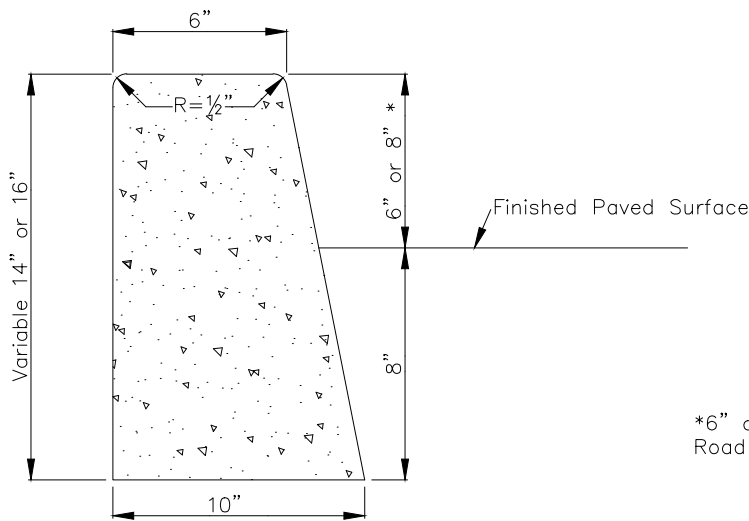


NOTES:

1. TOP OF CURB TO BE TROWELED AND HAVE A LIGHT BRUSH FINISH.
FACE OF CURB TO BE TROWELED AND HAVE A LIGHT BRUSH FINISH. GUTTER TO BE RUBBER FLOATED.
2. ¼" TO ½" FELT EXPANSION JOINT TO BE PLACED AT A MAXIMUM OF 40 FEET AND ADDITIONAL DEEP SCORE JOINTS AT A MAXIMUM OF 20 FEET.
3. ALL WORK SHALL CONFORM TO SECTIONS 73 AND 90 OF CALTRANS STANDARD SPECIFICATIONS, LATEST EDITION.
4. HUNT PROCESS CURING COMPOUND SHALL BE APPLIED TO FRESH CONCRETE BY ROLLING, BRUSHING, OR SPRAYING FOR CURING.
5. MINIMUM LONGITUDINAL GUTTER FLOWLINE SLOPE= 0.0015.
6. MINIMUM GUTTER DROP AROUND CURB RETURNS IS 0.15 FEET, EXCEPT AT VALLEY GUTTERS.

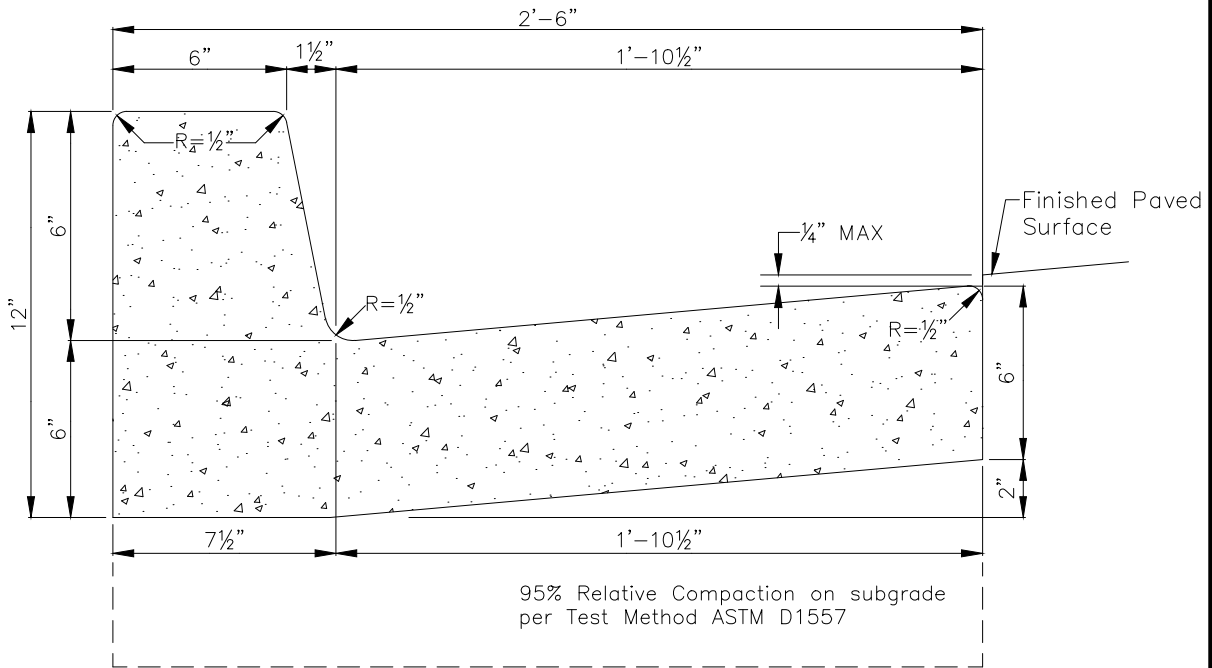

S:\ENG\STANDARD PLANS\County\ST-16 Typ Curb & Gutter.DWG 2-27-12 12:06:02 PM jchandler

DRAWN BY	_____
DATE	3/5/1980
REVISED BY	J.S.C.
DATE	2/28/2011

COUNTY OF MADERA

TYPICAL CURB AND GUTTER

DRAWING NO.	ST-16
-------------	-------