


V:\CAD Files\W Dwg\W7E-WS with C&G.DWG 10-17-11 11:11:49 AM eli.mcfarland

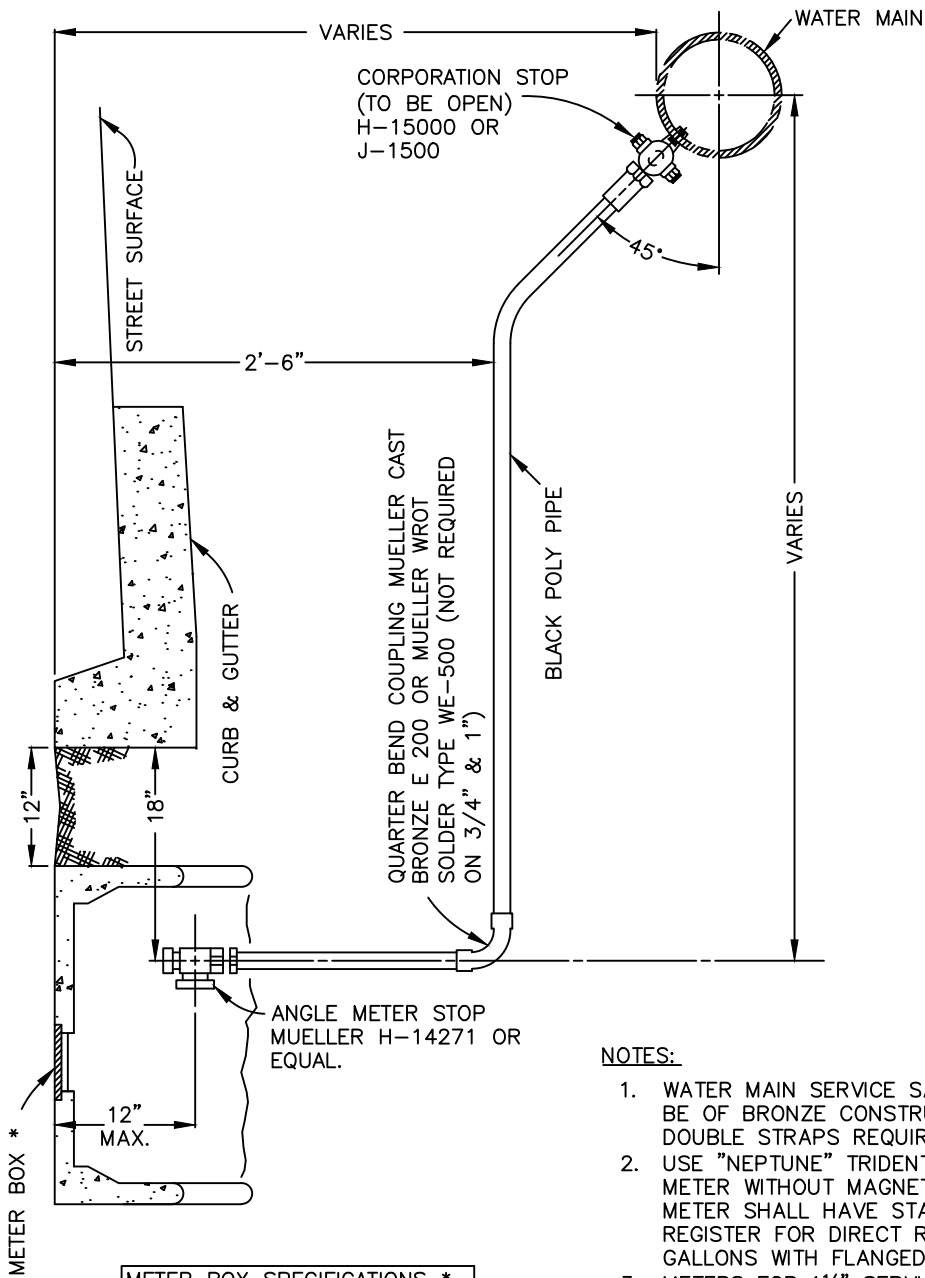

METER BOX SPECIFICATIONS *
1 1/4", 1 1/2", 2" SERVICE CHRISTY B-16
3/4", 1" SERVICE CHRISTY B-9

NOTES:

1. WATER MAIN SERVICE SADDLES SHALL BE OF BRONZE CONSTRUCTION. DOUBLE STRAPS REQUIRED.
2. USE "NEPTUNE" TRIDENT 8 WATER METER WITHOUT MAGNETIC HEAD. METER SHALL HAVE STANDARD REGISTER FOR DIRECT READING IN U.S. GALLONS WITH FLANGED ENDS.
3. METERS FOR 1 1/2" SERVICES OR LARGER TO BE INSTALLED AT THE DISCRETION OF THE COUNTY ENGINEER.
4. IF SIDEWALK ABUTS CURB AND GUTTER, ALL METER BOX DIMENSIONS BEGIN AT BACK OF SIDEWALK.

Spec's By _____	COUNTY OF MADERA	Date: 7-1-81			
Drawn By J. SHIELDS		Scale: NONE			
APPROVED BY _____		Drawing No. W-7E			
REVISIONS	8/1/02	8/21/09	4/22/2011		