


V:\CAD Files\W Dwg\W9-Pipe Bedding.DWG 10-17-11 11:12:09 AM eli.mcfarland

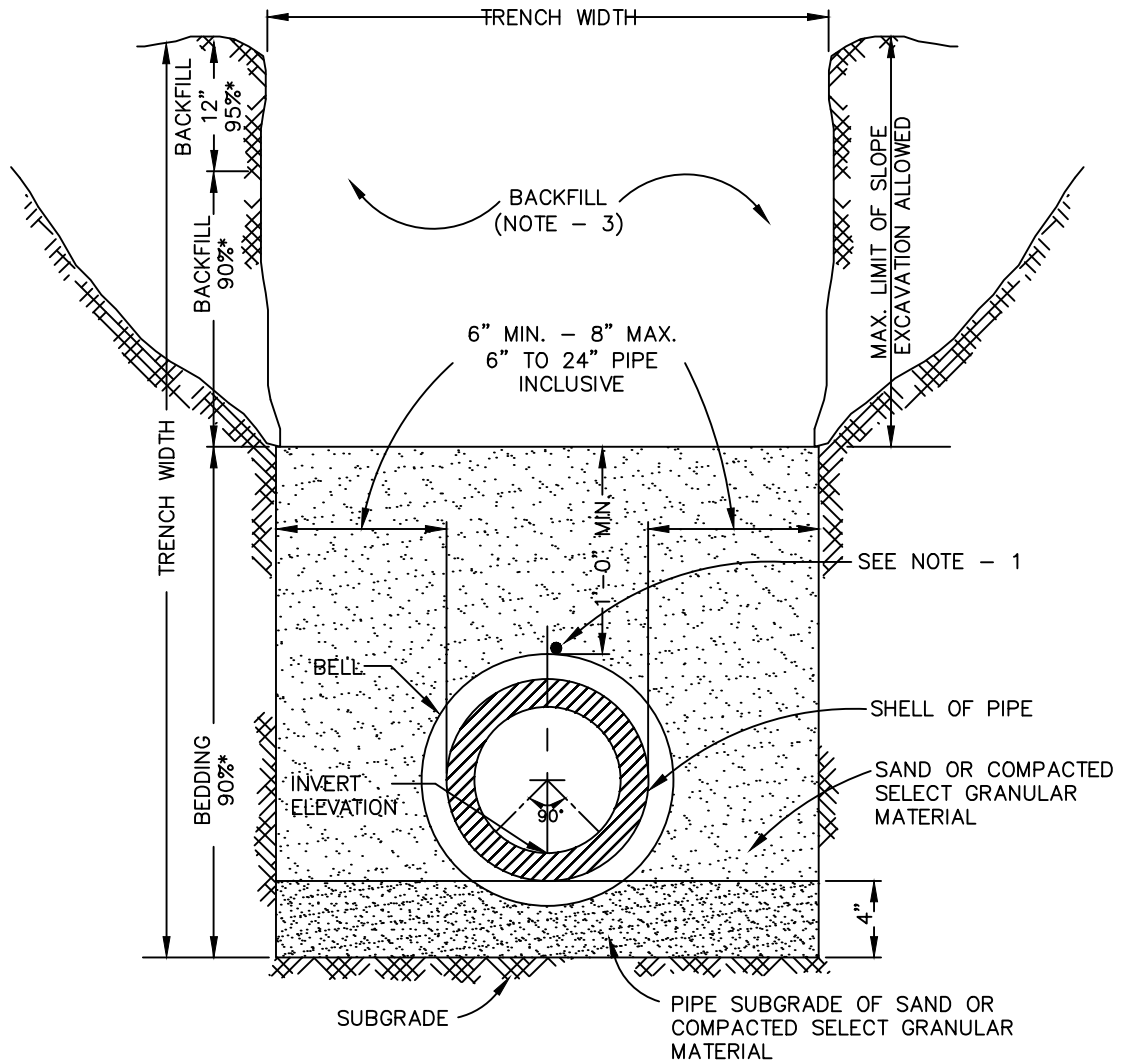

NOTES:

1. PLACE A #10 AWG INSULATED WIRE IN ALL WATERLINE TRENCHES FOR FUTURE LOCATION OF LINE WITH A METAL DETECTOR DEVICE. (BRING WIRES UP INTO VALVE BOXES FOR IMMEDIATE ACCESS).
2. ALL TRENCHES SHALL HAVE COMPACTION TESTS AT LOCATIONS DETERMINED BY COUNTY ENGINEER.
3. NATIVE SOIL BACKFILL, OR EQUIVALENT, FREE OF LARGE ROCKS AND DEBRIS 3" DIA. OR LARGER, MECHANICALLY COMPACTED IN 12" MAX. LIFTS (LOOSE MEASURE).
4. ANY VARIATION IN BACKFILL PLACEMENT OR METHOD OF COMPACTION SHALL BE SUBMITTED TO THE COUNTY ENGINEER FOR PRIOR APPROVAL.

*INDICATES RELATIVE DENSITY COMPACTION

Spec's By _____	COUNTY OF MADERA	Date: 7-1-81
Drawn By <u>J. SHIELDS</u>		Scale: NONE
APPROVED BY _____	PIPE BEDDING & TRENCH BACKFILL	Drawing No. W-9
REVISIONS		8/1/02
		4/22/2011