


ALLOW A MINIMUM OF 48 HOURS FOR CONCRETE TO SET BEFORE BACKFILLING

BACKFILL WITH NATIVE SOIL OR EQUIVALENT, FREE OF LARGE ROCKS AND DEBRIS 3" OR LARGER, MECHANICALLY COMPACTED IN 12" MAX. LIFTS.

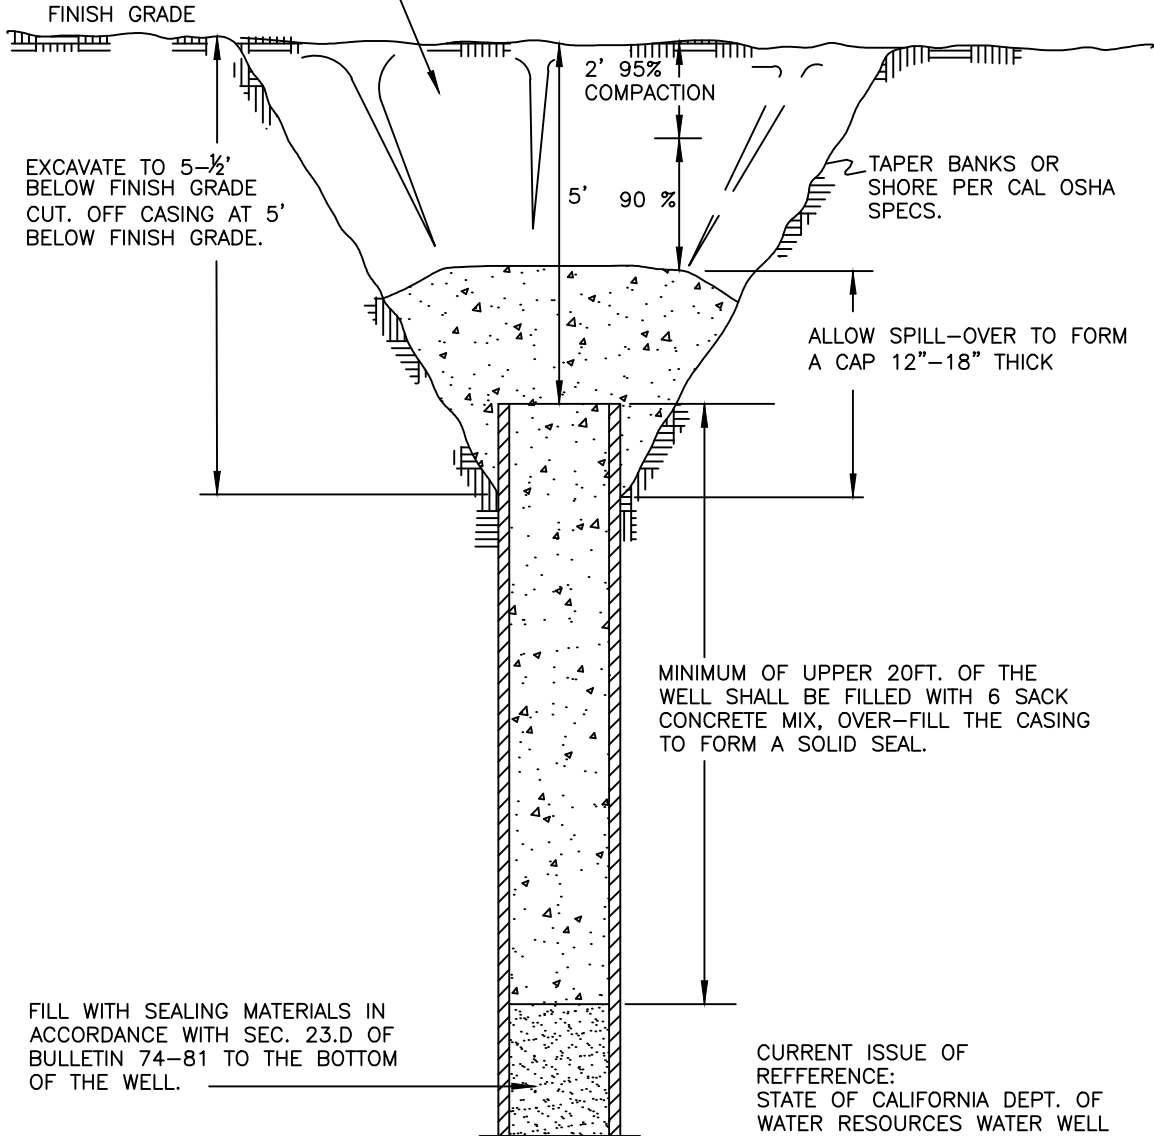

EXCAVATE TO 5- $\frac{1}{2}$ ' BELOW FINISH GRADE CUT OFF CASING AT 5' BELOW FINISH GRADE.

2' 95% COMPACTION

5' 90%

TAPER BANKS OR SHORE PER CAL OSHA SPECS.

ALLOW SPILL-OVER TO FORM A CAP 12"-18" THICK

MINIMUM OF UPPER 20FT. OF THE WELL SHALL BE FILLED WITH 6 SACK CONCRETE MIX, OVER-FILL THE CASING TO FORM A SOLID SEAL.

FILL WITH SEALING MATERIALS IN ACCORDANCE WITH SEC. 23.D OF BULLETIN 74-81 TO THE BOTTOM OF THE WELL.

CURRENT ISSUE OF REFERENCE: STATE OF CALIFORNIA DEPT. OF WATER RESOURCES WATER WELL STANDARD BULLETIN 74-91

V:\CAD Files\W Dwg\W15-Water Well Destruction.dwg 10-17-11 11:12:39 AM eli.mcfarland

Spec's By _____	COUNTY OF MADERA	Date: 8-21-09
Drawn By <u>J. SHIELDS</u>		Scale: NONE
APPROVED BY _____	WATER WELL DESTRUCTION	Drawing No. W-15
REVISIONS 4/29/2011		